

KATI HAR DIVISION

BANGALBAREE


TO SUIT 25KV AC RE

NOT TO SCALE


DOWN UP

KM 31.578 FROM BOE

—

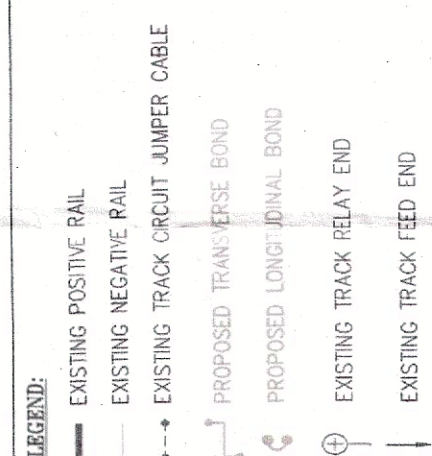

TOTAL	NO. OF PROPOSED TRACTION BOND ("Z" BOND) = 16
TOTAL	NO. OF "C" BOND = 8
TOTAL	NO. OF TRACK CIRCUITS = 14
TOTAL	NO. OF GLUED JOINTS = 46
TOTAL	NO. OF JUMPERS = 4

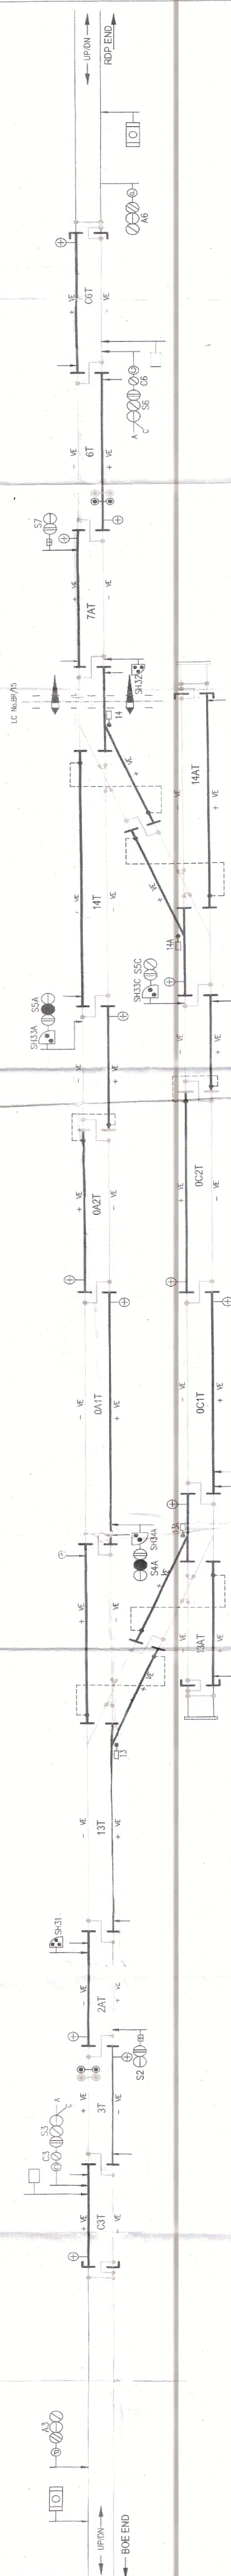

Note: All block joint must be replaced with Glued joint in B3Y yards.

ASTF/12002
2009/09/22

[illegible]

 LARSEN & TOUBRO LIMITED TRANSPORTATION INFRA-FC RAJIVJI'S SEC - EORC	RGR SA <i>Wade</i> 10/22	00	INITIAL SUBMISSION	ESCROW	REV No 21M4440	JOB NO. LE 15A R/ PROJECT EPC - RAU R/ PROJECT	REV-00 SCALE: NTS	RELEASED FOR ☐ INFORMATION ☒ APPROVAL ☐ CONSTRUCTION ☐ AS MADE	PROOF	<i>[Signature]</i>	CONSULTANT
	DRD DK <i>SL</i> 9/23										