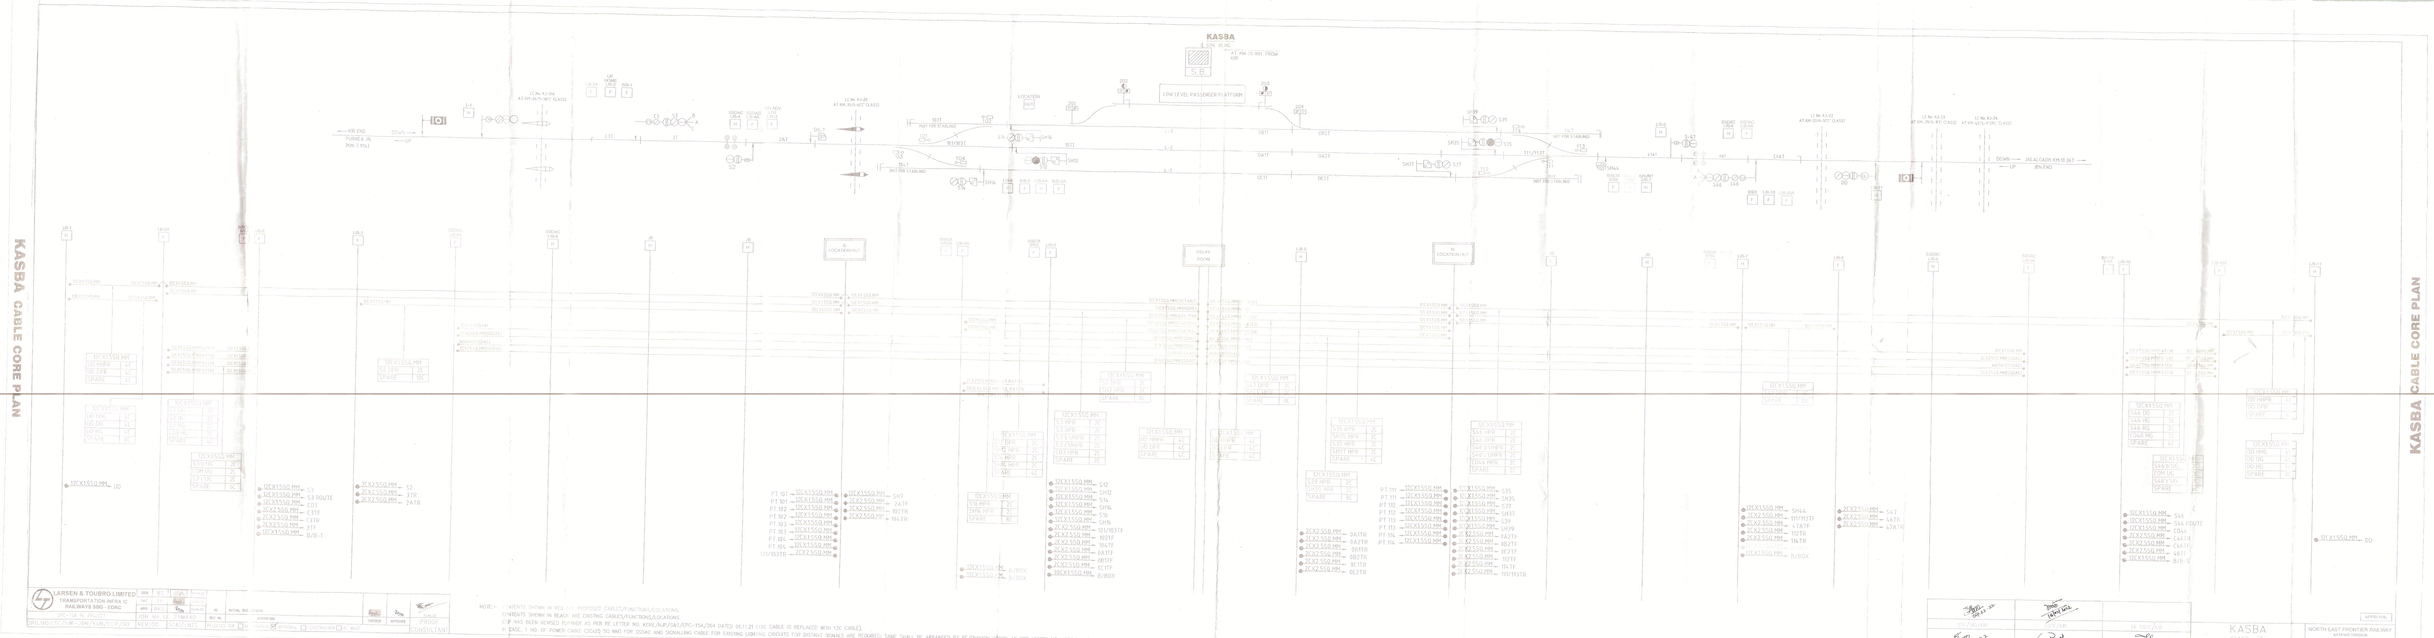

NOTE:- CONTENTS SHOWN IN RED ARE PROPOSED CABLES/FUNCTIONS/LOCATIONS.
CONTENTS SHOWN IN BLACK ARE EXISTING CABLES/FUNCTIONS/LOCATIONS.
C/P HAS BEEN REVISED FURTHER AS PER RE LETTER NO. KGRE/NJP/SAT/EPC-15A/264 DATED 06.11.21 (10C CABLE IS REPLACED WITH 12C CABLE).
IN CASE, 1 NO. OF POWER CARE (3X4Z5 50 MM) FOR 3DOAC AND SIGNALLING CABLE FOR EXISTING LIGHTING CIRCUITS FOR DISTANT SIGNALS ARE REQUIRED, SAME SHALL BE ARRANGED BY RE/DIVISION VIDE AS PER LETTER NO. KGRE/NJP/SAT/EPC-15A/264 DATED 03.11.21.