


← BSGN

PROPOSED CABLE ROUTE PLAN OF DANGTAL (DTX)

→ NBQ

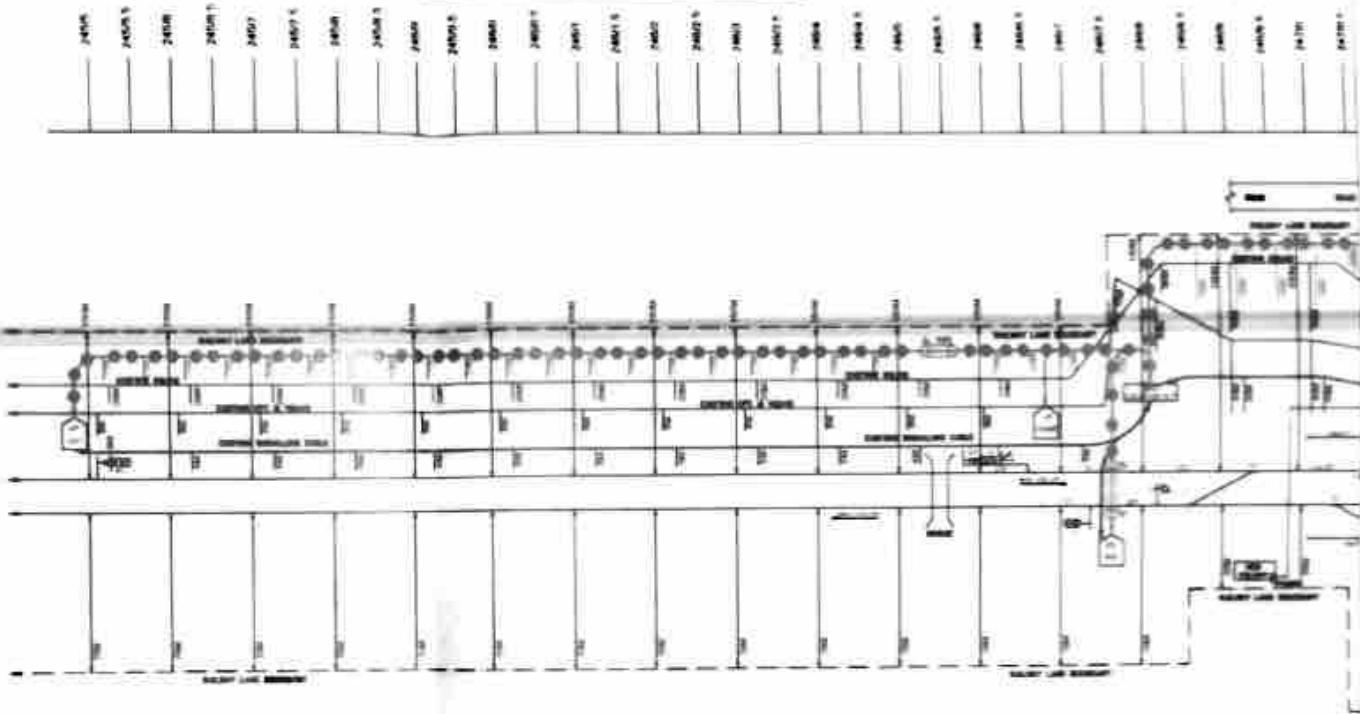

- LEGENDS**
- Shown as Existing OFC 4 QUAD & 6 QUAD Route
 - Shown as Existing Signaling Cable Route
 - Shown as Proposed Cable Route
 - Shown as Cable Route Marker 10Mtr Apart
 - Shown as Railway Boundary Line
 - Shown as Existing Electrical Cable Route

- NOTE :-**
1. Spacing between Electrical Power cable & S&T cable should be minimum 1mtr
 2. S&T cable shall be laid at minimum depth of 1mtr from G.L
 3. S&T cable shall be laid minimum at 1mtr distance from metallic part of OHE & TSS through HDPE/RCC pipes at 300mtr length either side
 4. S&T cable shall be laid at minimum 3mtr from OHE mast/ live conductor and minimum 1mtr from power cable
 5. HDD will be done at a minimum depth of 1.4mtr from G.L

TPL-KALINDEE (M)
[Signature]
 PM/S&T/NCR


<i>[Signature]</i> S&T/RYN/NO	<i>[Signature]</i> MOR/RCL/NCO	<i>[Signature]</i> S&T/RYN/NO	<i>[Signature]</i> S&T/RYN/NO	<i>[Signature]</i> S&T/RYN/NO	<i>[Signature]</i> S&T/RYN/NO	<i>[Signature]</i> S&T/RYN/NO	<i>[Signature]</i> S&T/RYN/NO	<i>[Signature]</i> S&T/RYN/NO	<i>[Signature]</i> S&T/RYN/NO
<i>[Signature]</i> S&T/RYN/NO		<i>[Signature]</i> S&T/RYN/NO	<i>[Signature]</i> S&T/RYN/NO	<i>[Signature]</i> S&T/RYN/NO	<i>[Signature]</i> S&T/RYN/NO	<i>[Signature]</i> S&T/RYN/NO	<i>[Signature]</i> S&T/RYN/NO	<i>[Signature]</i> S&T/RYN/NO	<i>[Signature]</i> S&T/RYN/NO

PROPOSED CABLE ROUTE PLAN OF DANGTAL (DTX)

NORTH-EAST FRONTIER RAILWAY | ALIPURDUAR DIVISION

BASED ON SIG PLAN NO

DRG NO: NFR/COMP/DTX/01
 SHT 01 OF 02
 DATE

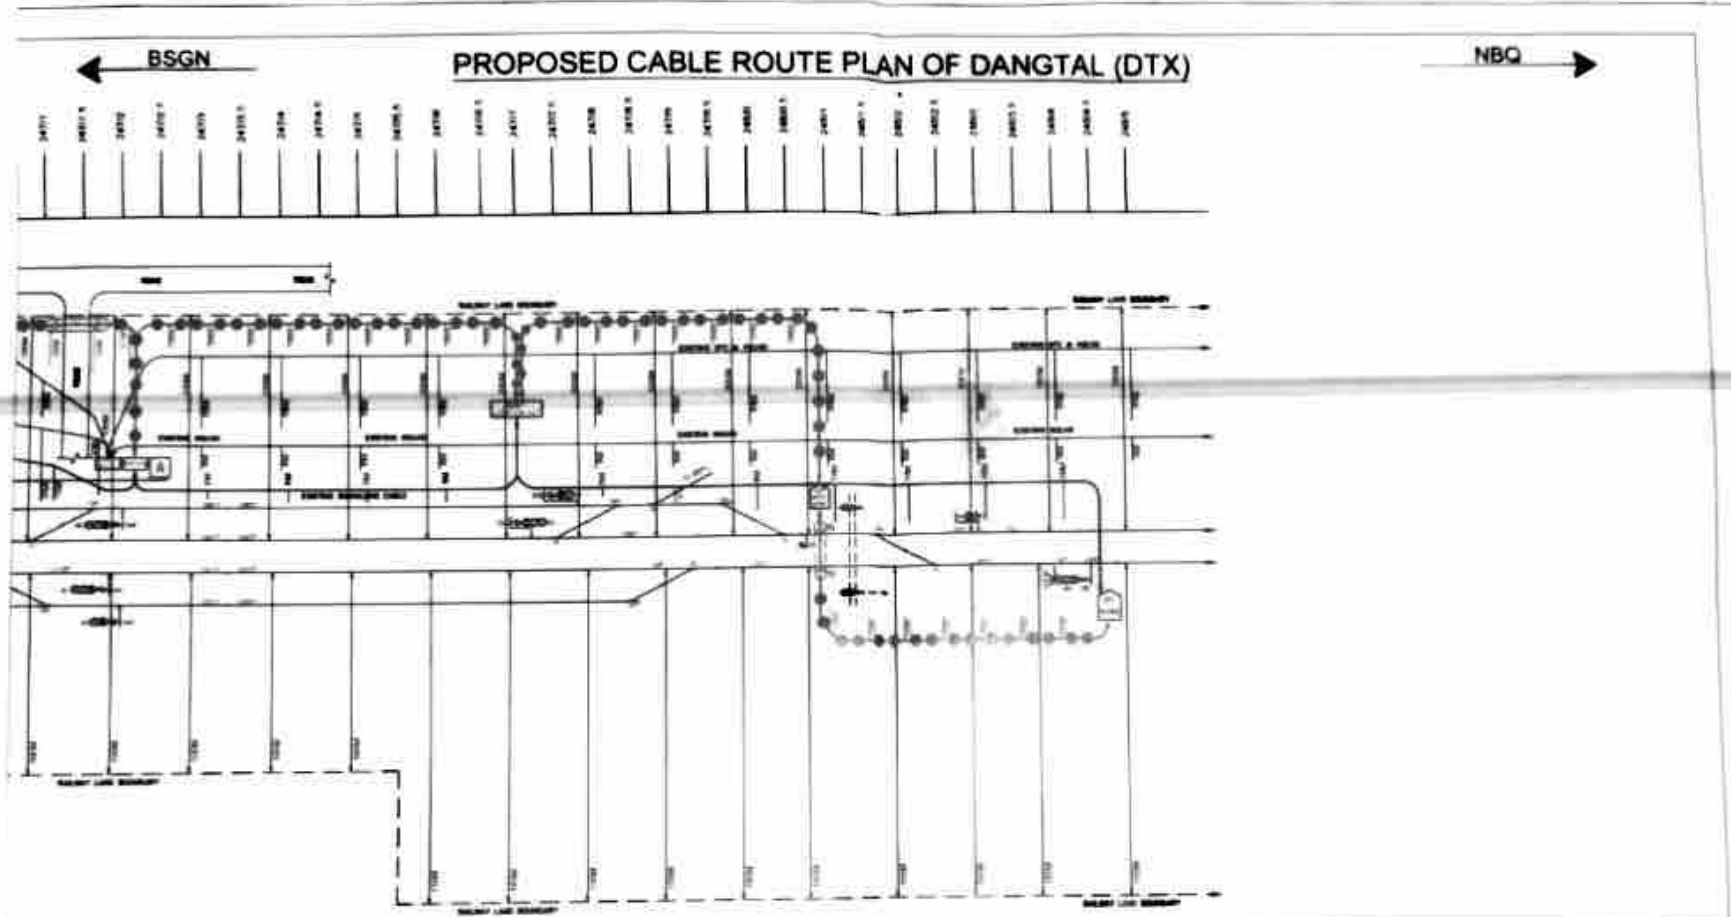

- NOTE :-**
1. Spacing between Electrical Power cable & S&T cable should be minimum 1mtr
 2. S&T cable shall be laid at minimum depth of 1mtr. from G.L
 3. S&T cable shall be laid minimum at 1mtr. distance from metallic part of OHE & TSS through HDPE/RCC pipes at 300mtr length either side
 4. S&T cable shall be laid at minimum 3mtr. from OHE mast/ live conductor and minimum 1mtr. from power cable
 5. HDD will be done at a minimum depth of 1.4mtr. from G.L

LEGEND :-

- Shown as Existing OHC 4 QUAD & 6 QUAD Route
- Shown as Existing Signaling Cable Route
- Shown as Proposed Cable Route
- Shown as Cable Route Marker 10Mtr Apart
- - - - - Shown as Railway Boundary Line
- Shown as Existing Electrical Cable Route

TPL - KALINDEE (N)	<i>[Signature]</i> NDR/S&T/ S&T/AVL/NCB	<i>[Signature]</i> MGR/AVL/ NDR	<i>[Signature]</i> R/S&T/ PNC/NCB	<i>[Signature]</i> SR.DITE/AVL	<i>[Signature]</i> NDR/AVL	<i>[Signature]</i> SR.DEND/AVL	<i>[Signature]</i> NDR/AVL AT NBQ	<i>[Signature]</i> SR.DEL/AVL	<i>[Signature]</i> NDR/AVL/TRG
<i>[Signature]</i> NDR/S&T/NCB	<i>[Signature]</i> S&T/AVL/NCB	<i>[Signature]</i> EXDPT/S&T/ PNC/NCB	<i>[Signature]</i> S&T/S&T/AVL	<i>[Signature]</i> S&T/AVL/AVL	<i>[Signature]</i> S&T/AVL/AVL	<i>[Signature]</i> S&T/AVL/AVL	<i>[Signature]</i> S&T/AVL/AVL	<i>[Signature]</i> S&T/AVL/AVL	<i>[Signature]</i> S&T/AVL/AVL

PROPOSED CABLE ROUTE PLAN OF DANGTAL (DTX)		DWG NO. KIN/CRP/DTX/1
		SHT 02 OF 02
NORTH-EAST FRONTIER RAILWAY ALIPURJAR DIVISION		DATE
BASED ON SIG PLAN NO.		